


Catalog Number
Notes
Type

## APPLICATION GUIDE: STANDARD SPECIAL SIGNAGE

Lithonia Lighting offers special signage signs to suit many applications. The Signature and Quantum families highlighted below are illuminated with energy-efficient, long-life Light Emitting Diodes (LEDs).

**WARRANTY** — This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: [www.acuitybrands.com/support/warranty/terms-and-conditions](http://www.acuitybrands.com/support/warranty/terms-and-conditions)

**Note:** Actual performance may differ as a result of end-user environment and application. Specifications subject to change without notice.

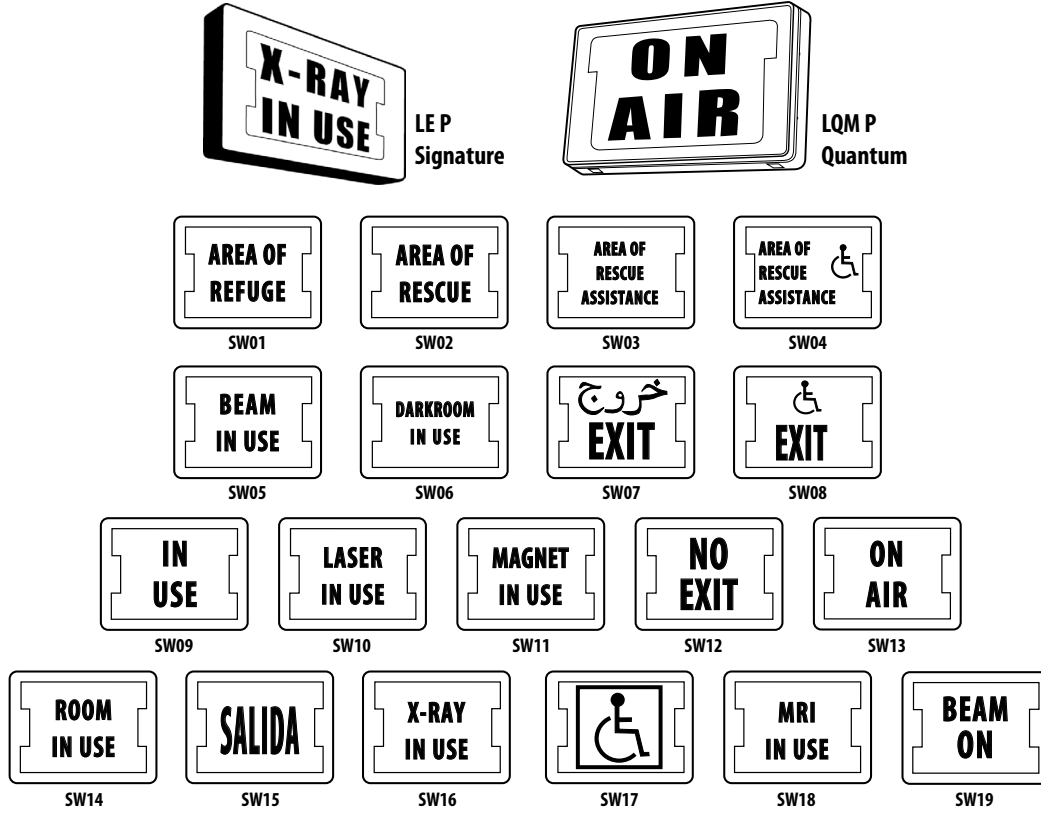

### ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

**Example:** LE P 1 R EL N SW02

Family	Face type	Housing color	Number of faces	Letter color	Input voltage	Operation
LE Signature die-cast aluminum sign <sup>1</sup>	P Panel	(blank) Matte black, brushed aluminum face	1 Single face	R Red	(blank) 120 thru 277V, 50/60Hz (only required with LE series) <sup>1</sup>	(blank) AC only
LQM Quantum thermoplastic sign <sup>2,3,4</sup>		W White	2 Double face	G Green	120/277 Dual voltage <sup>3,5</sup>	EL N Nickel-cadmium battery
			3 Single face with extra faceplate and color panel <sup>4</sup>			

### Special wording

SW01	AREA OF REFUGE <sup>6</sup>	SW06	DARK ROOM IN USE <sup>6,7</sup>	SW11	MAGNET IN USE <sup>6,7</sup>	SW15	SALIDA <sup>9</sup>
SW02	AREA OF RESCUE <sup>6</sup>	SW07	EXIT Arabic/English <sup>8,9</sup>	SW12	NO EXIT <sup>9</sup>	SW16	X-RAY IN USE <sup>6,7</sup>
SW03	AREA OF RESCUE ASSISTANCE <sup>6</sup>	SW08	EXIT with access pictogram <sup>9</sup>	SW13	ON AIR <sup>6,7</sup>	SW17	Handicap Symbol <sup>6</sup>
SW04	AREA OF RESCUE ASSISTANCE with access pictogram <sup>6</sup>	SW09	IN USE <sup>6,7</sup>	SW14	ROOM IN USE <sup>6,7</sup>	SW18	MRI IN USE <sup>6,7</sup>
SW05	BEAM IN USE <sup>6,7</sup>	SW10	LASER IN USE <sup>6,7</sup>			SW19	BEAM ON <sup>6,7</sup>

### Notes

- See spec sheet [LE-LRE](#) for complete specifications
- Only available in white housing. EL N operation only available in red letters for LQM family.
- See spec sheet [LQM](#) for complete specifications
- Must be ordered with LQM series. Not available with single (1) or double (2) face in description.
- Only required when ordering LQM family (ex: LQM P W 3 R 120/277 SW01).
- UL48 listing as an electric sign only.
- Not available with EL N operation.
- Only available in red letters.
- Not available with UL924 listing.

# CUSTOM SIGNAGE

---

## MAINTENANCE

All life safety equipment, including emergency lighting for path of egress must be maintained, serviced, and tested in accordance with all National Fire Protection Association (NFPA) and local codes. Failure to perform the required maintenance, service, or testing could jeopardize the safety of occupants and will void all warranties.